


METER & CIRCUIT BREAKER ARRANGEMENT (5 OR MORE METERS)

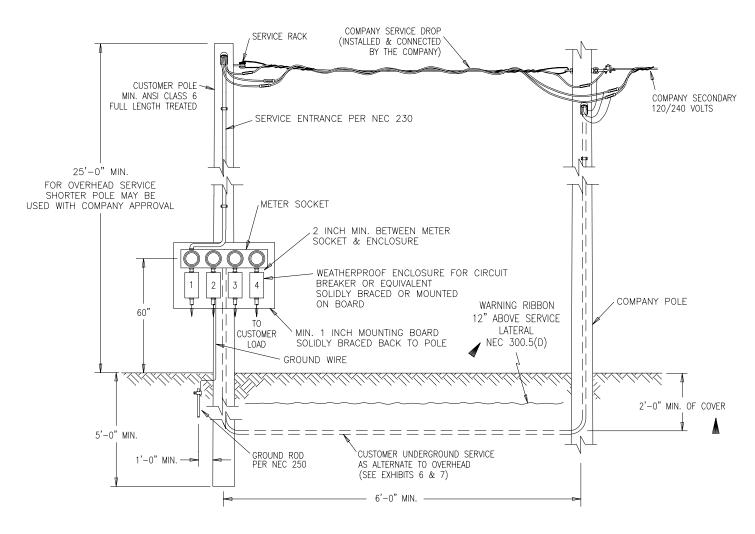

NOTES:

- 1. ALL SOCKETS (INSIDE & OUT) AND BREAKERS MUST BE PERMANENTLY & PLAINLY MARKED TO DESIGNATE THE PARTICULAR UNIT SERVED.
- 2. A MAIN DISCONNECT MEANS MAY BE REQUIRED, PER NEC.
- 3. ALL WOODEN PRODUCTS TO BE CCA PRESSURE TREATED.
- 4. ALL HARDWARE TO BE BONDED AND GROUNDED PER NEC 250.
- 5. METER SOCKET(S) MAY BE CONNECTED TO AN EXTERNAL GROUND ROD IF REQUIRED BY LOCAL INSPECTION AUTHORITIES.
- 6. FOR CUSTOMER/COMPANY RESPONSIBILITIES SEE COMPANY SPECIFIC SERVICE GUIDE EXHIBIT 19.

SUSSEX RURAL ELECTRIC COOPERATIVE 64 County Route 639 Sussex, New Jersey 07461 METERING & SERVICE FACILITIES FOR MOBILE HOME PARKS & TRAVEL TRAILER PARKS Service Guide Rev. 1 Date 6/07